


STANDARD TRENCH SECTIONS

INSIDE DIAMETER OR EQUIVALENT DIAMETER OF PIPE	REQUIRED TRENCH WIDTH ON EACH SIDE OF PIPE
24 in. (600 mm) AND LESS	9 in. (225 mm)
GREATER THAN 24 in. (600 mm) UP TO 48 in. (1.2 m)	12 in. (300 mm)
GREATER THAN 48 in. (1.2 m)	18 in. (450 mm)

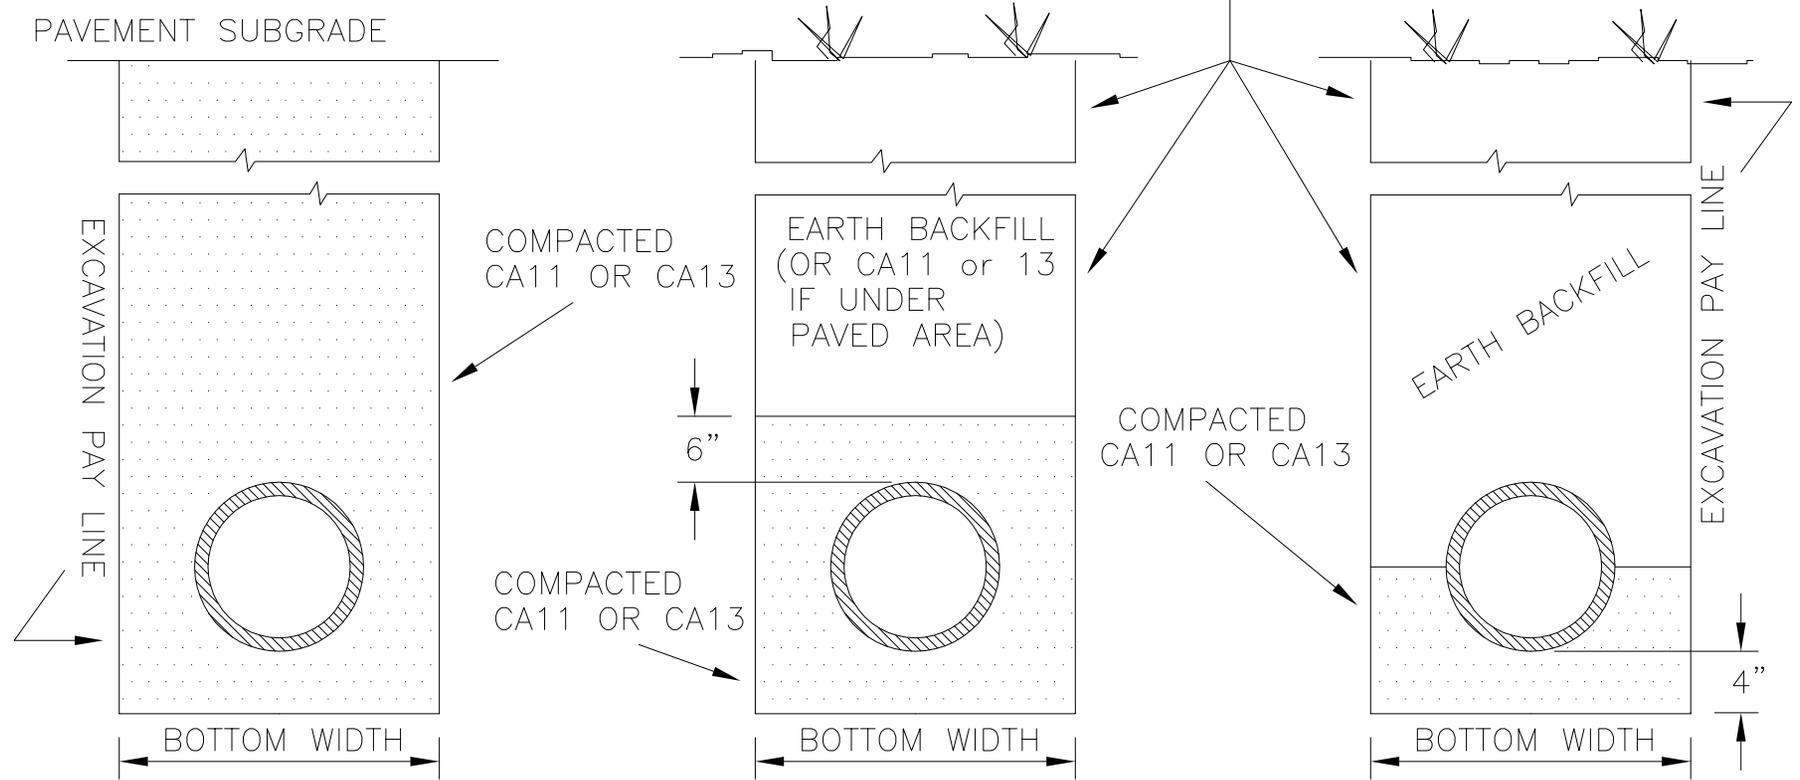

PAVED AREAS
WATER, STORM

SANITARY

UNPAVED AREAS
WATER, STORM