


WATER SERVICE DETAIL

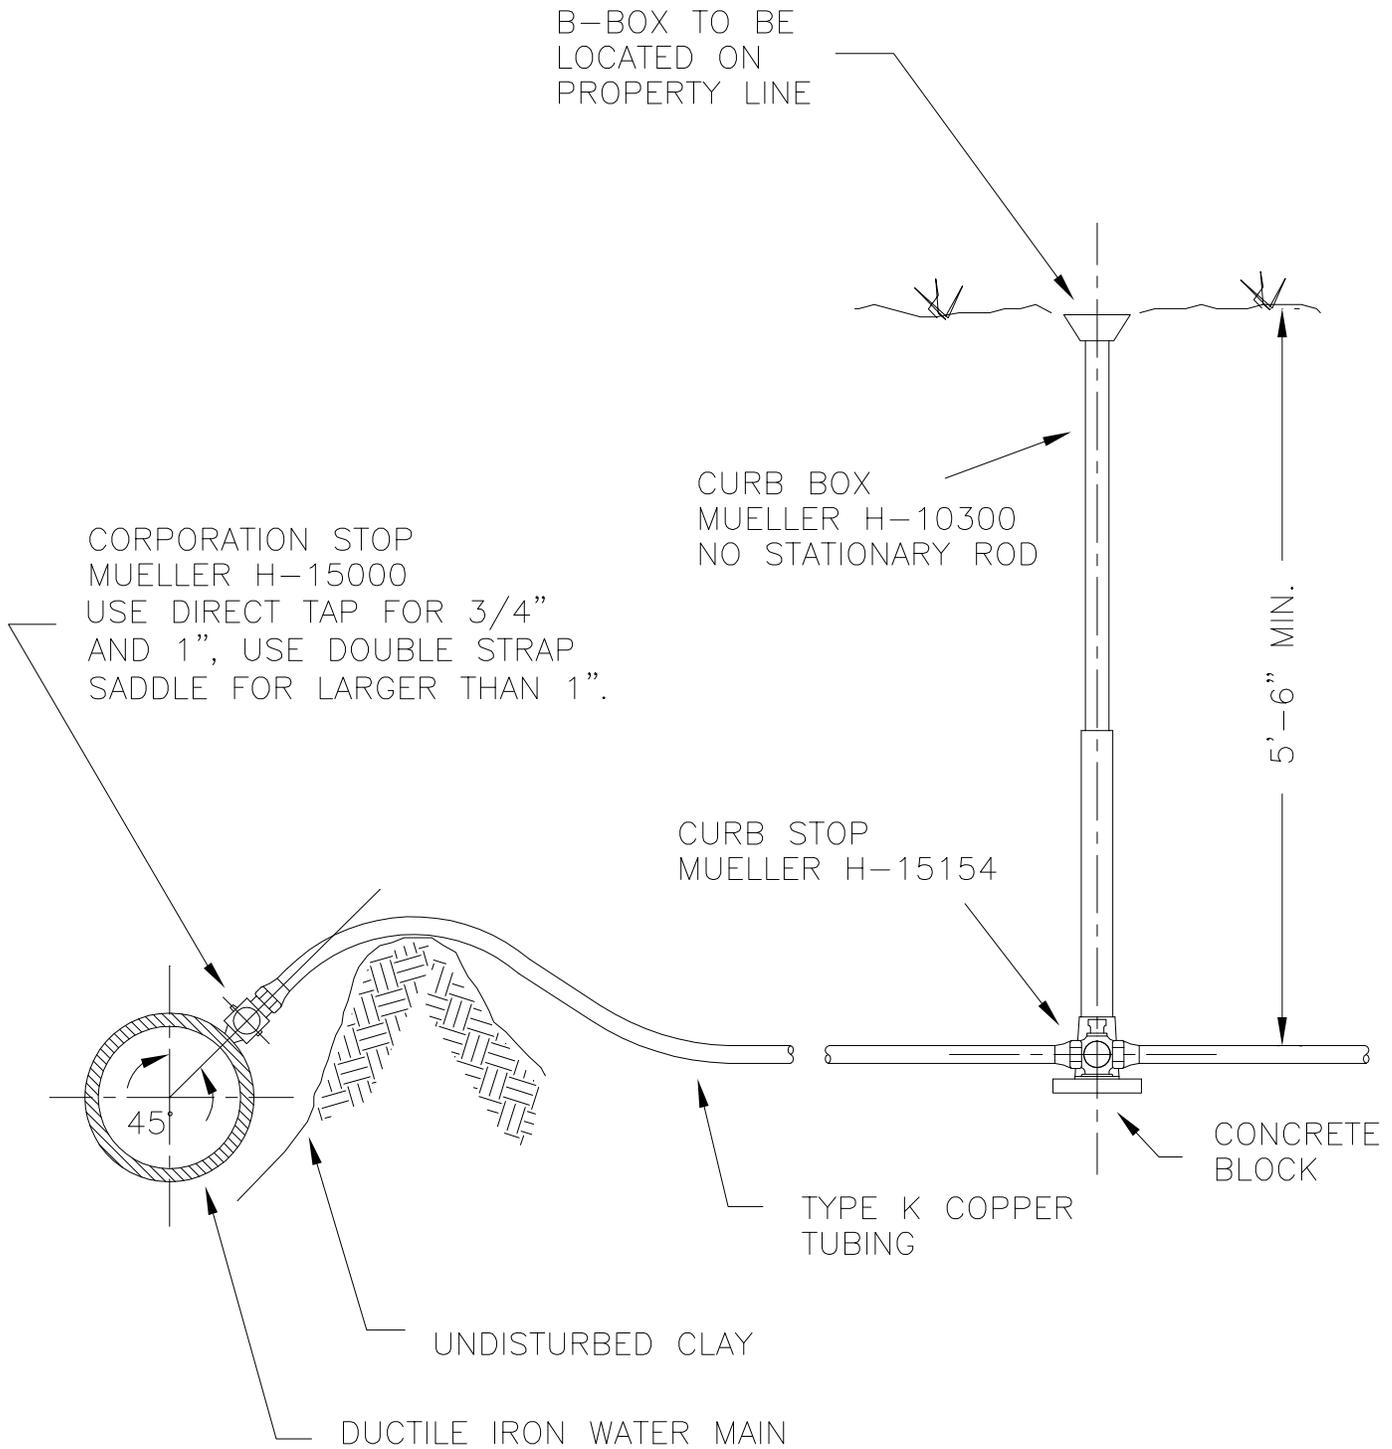

WATER SERVICE LINE SHALL BE IN A SEPARATE TRENCH 10 FT. FROM THE SANITARY SEWER SERVICE LINE OR IN THE SAME TRENCH BUT ON A SHELF 18" ABOVE THE SEWER LINE, IN WHICH CASE THE SEWER PIPE MATERIAL SHALL BE DUCTILE IRON OR SCHEDULE 40 PVC WITH SOLVENT WELD JOINTS.