


# WATER VALVE VAULT

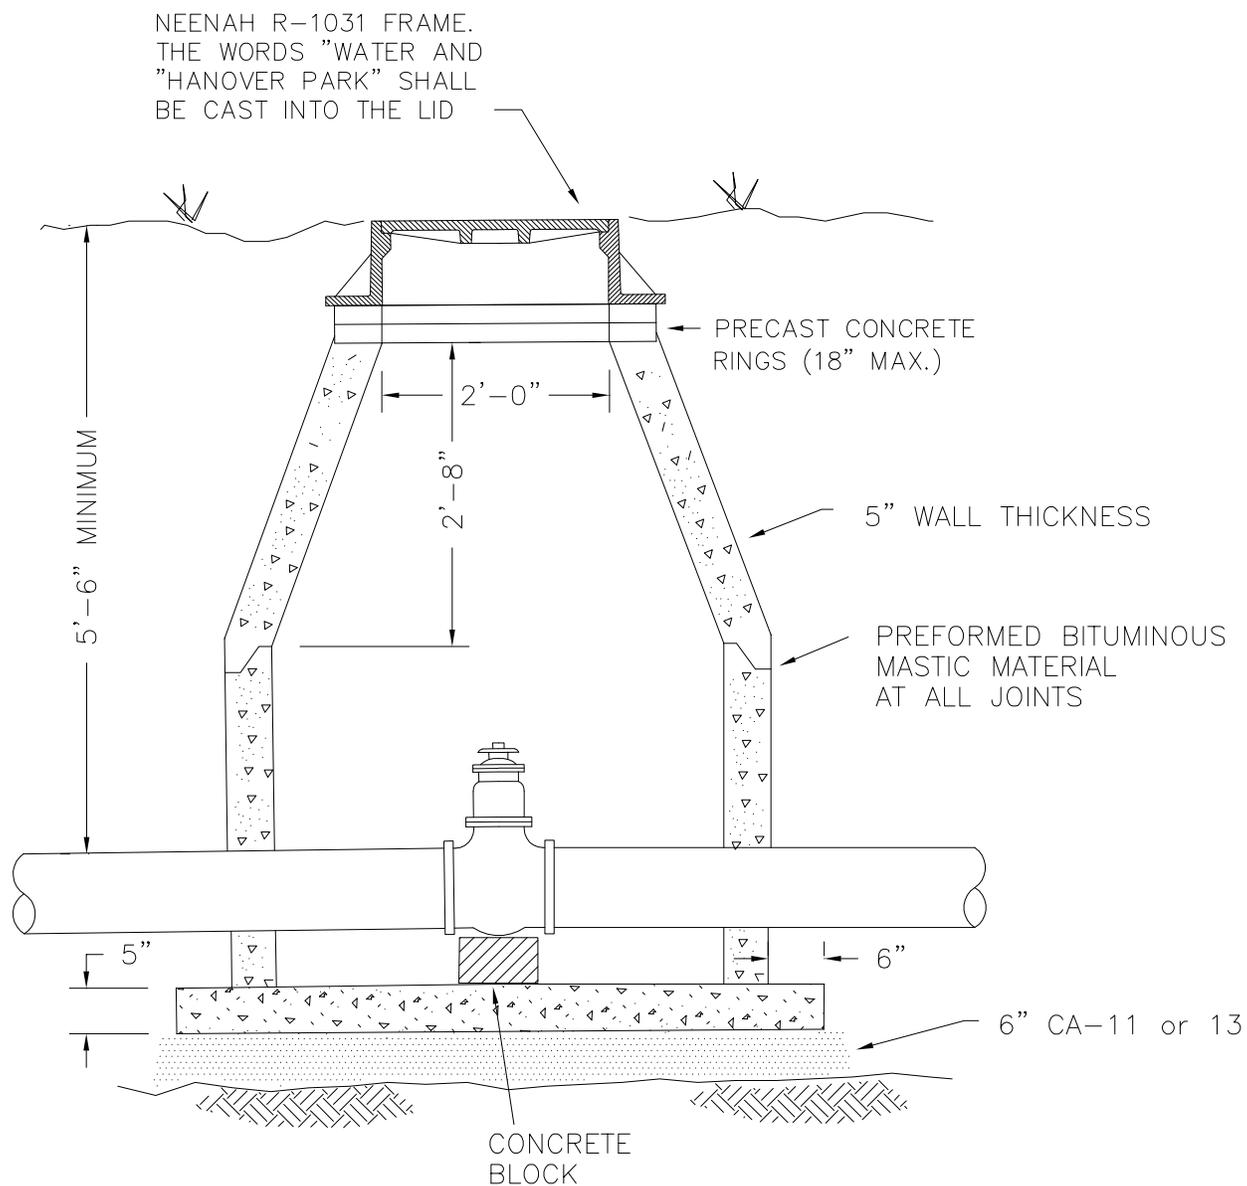

INSIDE DIAMETER SHALL BE 48" FOR WATER MAIN 6" THROUGH 10"  
AND 60" FOR WATER MAIN 12" AND OVER

VALVES SHALL BE RESILIENT WEDGE GATE VALVES CONFORMING  
TO AWWA C509 AND SHALL BE MUELLER OR CLOW OR WATEROUS